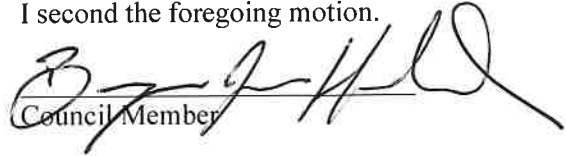


ROLL CALL VOTING:	YES	NO
Mayor Brent Winder (tie only)	[]	[]
Council Member Ben Hillyard	[X]	[]
Council Member Dorel Kynaston	[X]	[]
Council Member Janet Lunt	[X]	[]
Council Member Kari Malkovich	[X]	[]
Council Member David Pratt	[X]	[]

I move that this Ordinance be adopted.


Council Member

I second the foregoing motion.


Council Member

ORDINANCE NO. 2022-08

AN ORDINANCE AMENDING THE CITY OF WOODLAND HILLS FLOW RATE FOR FIRE HYDRANTS

WHEREAS the City of City of Woodland Hills has adopted a standard flow rate for Fire Hydrants; and

WHEREAS the City of Woodland Hills has determined that the minimum fire flow rate should be increased; and

WHEREAS the City of Woodland Hills Planning Commission held a public hearing on March 16, 2022, for the purpose of amending the fire flow standards called for in City Code Title 10-7-1C (6) and the City of Woodland Hills Development and Construction Standards 2.8.6 3(D); and

WHEREAS the City of Woodland Hills City Council held a public hearing on March 22, 2022, for the purpose of amending the fire flow standards called for in City Code Title 10-7-1C (6) and the City Development and Construction Standards 2.8.6 3(D); and

WHEREAS public notices for the meetings, were posted and published according to Utah State Code and copies of the proposed changes to the ordinance were available for inspection in the city offices.

NOW THEREFORE, be it ordained by the City Council of the City of Woodland Hills the following changes be made to City Code Title 10-7-1C (6) and the City of Woodland Hills Development and Construction Standards 2.8.6 3(D) Fire Hydrants:

City Code Title 10-7-1C (6)

6. The lot builder/owner or developer, through a licensed professional engineer licensed in the State of Utah, shall demonstrate that a minimum fire-flow rate of three thousand (3,000) gallons per minute is available at each hydrant required in this Section and that this flow can be sustained a minimum of 3 hours for a total of five hundred forty thousand (540,000) gallons.

Development and Construction Standards 2.8.6 3(D) Fire Hydrants

3(D)- The owner or developer, through a licensed professional engineer licensed in the State of Utah, shall demonstrate that a minimum fire-flow rate of 3,000 gallons per minute is available at each hydrant required in this Section and that this flow can be sustained a minimum of 3 hours for a total of 540,000 gallons.

ADOPTED by the City Council of Woodland Hills this 22nd day of March 2022.


Brent Winder, Mayor

Attest:

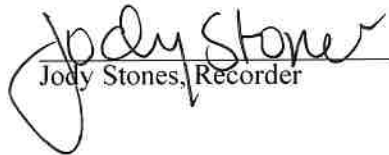

Jody Stones, Recorder

CERTIFICATE OF POSTING ORDINANCE
For the City of Woodland Hills

I, the duly appointed and acting Recorder for the City of Woodland Hills, hereby certify that
copies of the foregoing Ordinance No. 2022-00 were posted at three public places within the
municipality this 23rd day of March which public places are:

1. City Information Bulletin Board, 200 S. Woodland Hills Drive
2. Woodland Hills City Center, 690 S. Woodland Hills Drive
3. Woodland Hills Web Site, www.woodlandhills-ut.gov

Dated this 23rd day of March 2022.


Jody Stones, Recorder