


CONCRETE COLLAR WITH FIBER MESH REINFORCEMENT APWA 03 20 00 (CONCRETE REINFORCING)

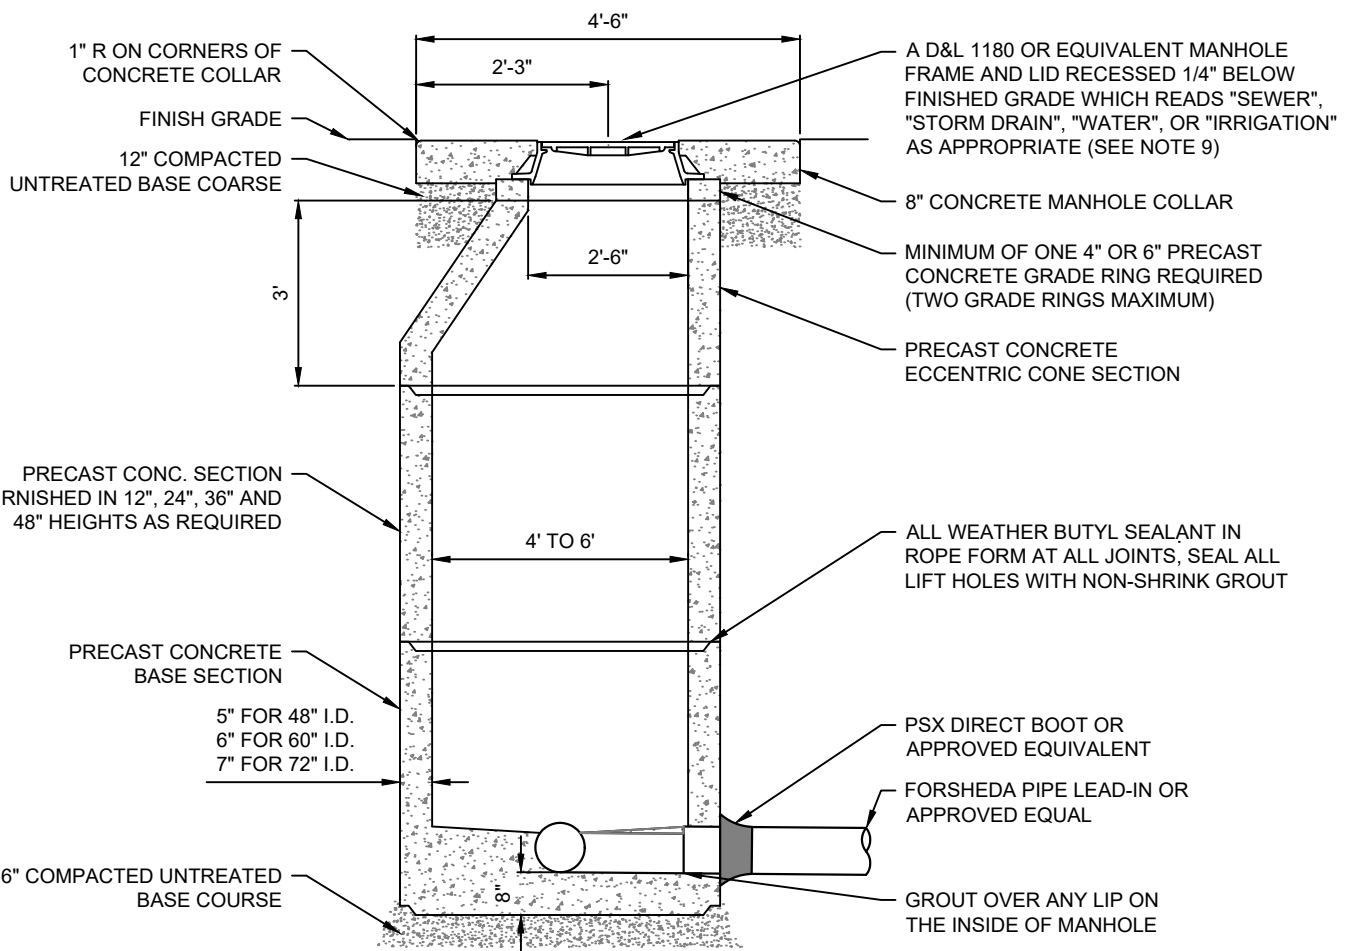

NOTES:

1. USE 4' I.D. MANHOLES FOR MAIN LINES LESS THEN 18" IN DIAMETER; 5' I.D. MANHOLES FOR MAIN LINES 18" TO 30" IN DIAMETER, AND 6' I.D. FOR MAIN LINES GREATER THAN 30" IN DIAMETER.
2. FLAT LIDS MAY BE USED IN LIEU OF ECCENTRIC CONES WHERE NECESSARY. FLAT LIDS SHALL BE OF ECCENTRIC DESIGN AND MEET H20 LIVE LOADING. NO FLAT RING AND COVERS WILL BE ALLOWED UNLESS APPROVED BY CITY ENGINEER OR HIS/HER DESIGNEE.
3. MANHOLE RIMS PLACED IN FIELDS SHALL HAVE SOLID LIDS AND BE BURIED 2 FEET DEEP.
4. MANHOLE RIMS OUT OF STREETS SHALL BE PLACED 4 INCHES ABOVE GRADE.
5. CONCRETE COLLAR AND RIM SHALL BE INSTALLED 1/4" BELOW PAVEMENT SURFACE AFTER THE 1 YEAR PRESERVATION COAT.
6. MANHOLE COLLARS AND RINGS SHALL BE PROTECTED BY A COVERING DURING A SEAL COAT.
7. STORM MANHOLES MAY HAVE FLAT BOTTOMS IN THE BASES.
8. CONCRETE COLLAR SHALL BE PLACED AFTER THE 1 YEAR PRESERVATION COAT WHEN APPLICABLE.
9. IN PAVED AREAS WITH A SLOPE GREATER THAN 5% USE AN EJIW 3624 TWIST BASE OR APPROVED EQUIVALENT.
10. ALL STORM DRAIN MANHOLES CONNECTED TO STORM DRAIN INLETS SHALL HAVE A FLAT BOTTOM WITH 18" MIN. FROM FLOW LINE TO BOTTOM OF BOX.
11. ALL STORM DRAIN MANHOLES NOT CONNECTED TO AN INLET BOX SHALL HAVE A TROUGH.

12	DRAWN BY: BDS
	CHECKED BY: BT
	SCALE: N.T.S.
	DATE: 2/14/2018
	STANDARD #

CONSTRUCTION STANDARDS

MANHOLE DETAIL

680 S. Woodland Hills Dr.
Woodland Hills, UT 84653
Phone: 801-423-1962
Fax: 801-423-3501
www.woodlandhillsut.com

CITY OF
WOODLAND HILLS